


Clearance envelope for grain bins filled by permanently installed augers, conveyors or elevators

- P** = Probe clearance
18ft (5.5m) required by Rule 234F1a
- H** = Horizontal clearance
15ft (4.6m) required by Rule 234F1a
- T** = Transition clearance


- V₁** = Vertical clearance above a building required by Rule 234C
- V₂** = Vertical clearance required by Rule 232B

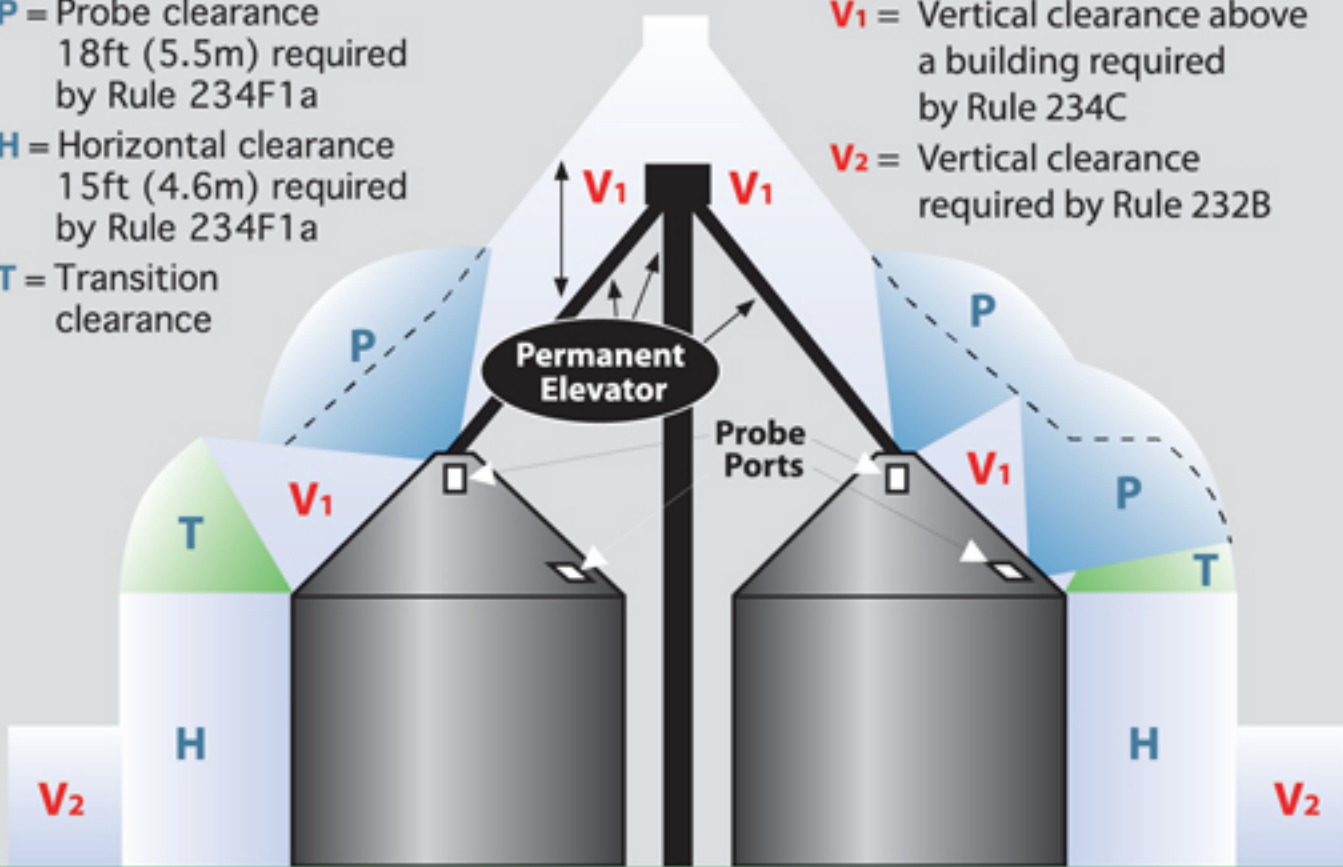

From IEEE Std. C2-2023, "National Electrical Safety Code." © Copyright 2022 by IEEE. All rights reserved.

Clearance envelope for grain bins filled by portable augers, conveyors or elevators

ELEVATION

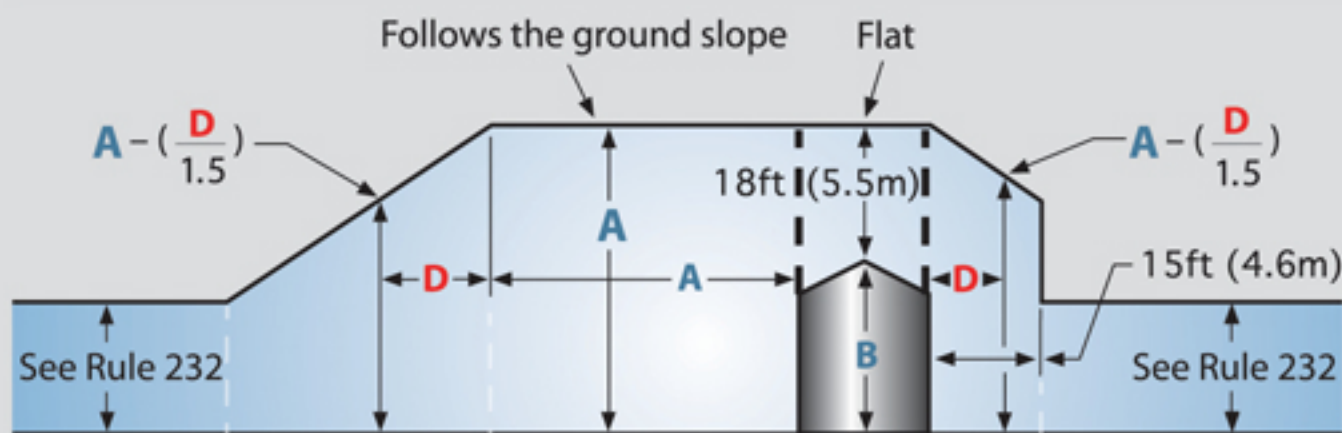


- B** = Height of highest filling or probing port on grain bin
- H** = B + 18ft (5.5m)
- D** = Variable horizontal dimension

In the area of sloped clearance, the vertical clearance is reduced by 1ft (300mm) for each additional 1.5ft (450mm) of horizontal distance from the grain bin.

PLAN VIEW

LOADING SIDE

See Rule 232
Area of sloped clearance

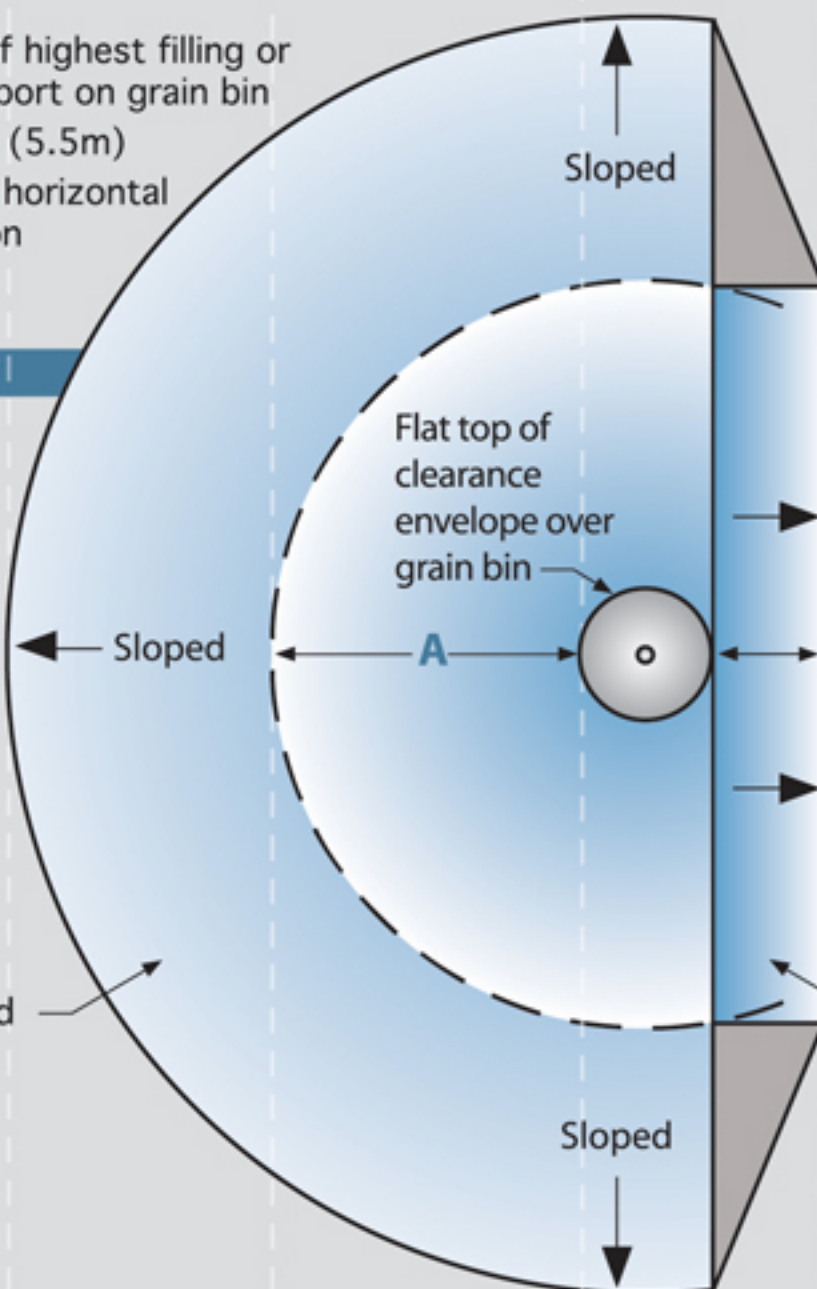

NONLOADING SIDE

Sloped
15ft (4.6m)
Sloped
Rule 232 area
Area of sloped clearance

From IEEE Std. C2-2023, "National Electrical Safety Code." © Copyright 2022 by IEEE. All rights reserved. The IEEE disclaims any responsibility or liability resulting from the placement and use in the described manner.